
LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:120.06V I:0.0213A P:1.5234W PF:0.5966 Freq:60.00Hz Lamp Flux:118.102x1 lm		
NAME: 30763CRBKAB	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:


DATA OF LAMP		PHOTOMETRIC DATA		Eff: 77.52 lm/W	
MODEL		Imax(cd)	43.67	S/MH(C0/180)	1.03
NOMINAL POWER(W)	--	LOR(%)	100.0	S/MH(C90/270)	2.01
RATED VOLTAGE(V)	--	TOTAL FLUX(lm)	118.10	η UP,DN(C0-180)	1.3,47.8
NOMINAL FLUX(lm)	118.102	CIE CLASS	DIRECT	η UP,DN(C180-360)	1.8,49.1
LAMPS INSIDE	1	η up(%)	3.1	CIBSE SHR NOM	0.75
TEST VOLTAGE(V)	--	η down(%)	96.9	CIBSE SHR MAX	0.95

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

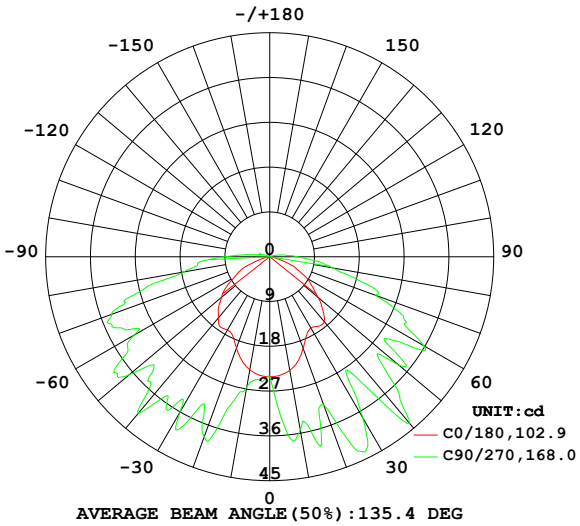

AVERAGE BEAM ANGLE(50%):135.4 DEG

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

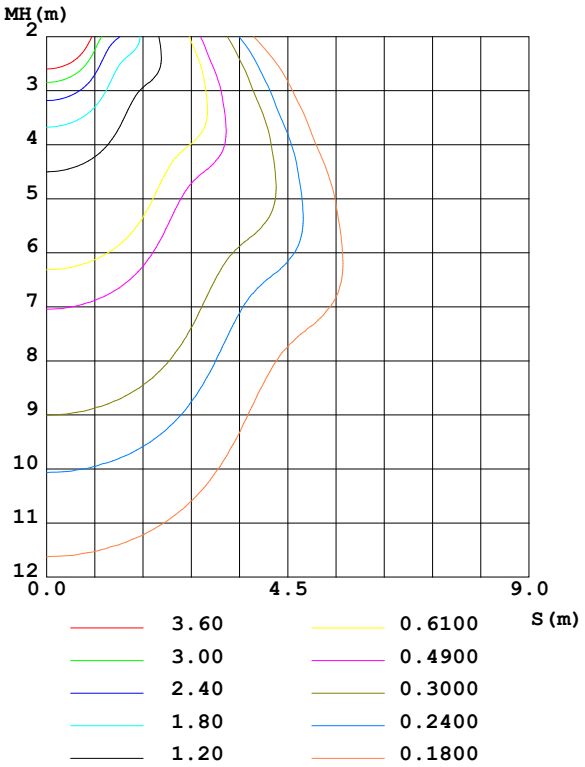

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: 10.0deg/s
Temperature:24.5℃
Operators:xiaoxin
Test Date:2026-09-29

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
Humidity:60.0%
Test Distance:9.000m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum,lamp
10	23.17	26.38	35.37	28.10	23.07	21.91	26.66	19.84	0- 10	2.299	2.299	1.95,1.95
20	19.64	25.91	31.65	26.50	19.58	29.66	38.48	18.31	10- 20	7.257	9.556	8.09,8.09
30	16.56	24.72	37.43	29.09	16.97	26.53	36.11	26.45	20- 30	12.43	21.99	18.6,18.6
40	17.04	28.19	43.67	24.64	16.08	21.12	40.99	23.34	30- 40	15.92	37.91	32.1,32.1
50	12.69	21.66	33.84	23.09	12.62	28.18	36.92	23.10	40- 50	19.01	56.92	48.2,48.2
60	8.664	19.36	35.73	19.57	8.231	19.79	31.42	22.22	50- 60	19.80	76.71	65,65
70	4.043	16.22	22.64	15.42	3.787	19.56	33.84	17.62	60- 70	18.53	95.24	80.6,80.6
80	0.6529	8.108	12.74	7.826	0.6286	9.440	17.44	10.89	70- 80	12.67	107.9	91.4,91.4
90	0.0008	3.967	5.687	3.274	0.0016	5.239	9.149	5.659	80- 90	6.492	114.4	96.9,96.9
100	0.0055	1.153	2.051	1.638	0.0191	1.024	2.414	1.665	90-100	2.615	117.0	99.1,99.1
110	0.0207	0.3766	0.4331	0.0913	0.0359	0.1625	1.162	0.2222	100-110	0.6656	117.7	99.6,99.6
120	0.0359	0.0470	0.1005	0.0693	0.0550	0.0847	0.1509	0.0628	110-120	0.1421	117.8	99.8,99.8
130	0.0518	0.0541	0.1159	0.0775	0.0734	0.0973	0.1294	0.0709	120-130	0.0672	117.9	99.8,99.8
140	0.0669	0.0674	0.1264	0.0856	0.0853	0.1020	0.1391	0.0754	130-140	0.0665	118.0	99.9,99.9
150	0.0829	0.0769	0.1255	0.0886	0.0956	0.1035	0.1292	0.0761	140-150	0.0578	118.0	99.9,99.9
160	0.0940	0.0840	0.1216	0.0901	0.1020	0.1036	0.1188	0.0775	150-160	0.0438	118.1	100,100
170	0.1028	0.0941	0.1222	0.0864	0.1068	0.1028	0.1211	0.0805	160-170	0.0276	118.1	100,100
180	0.1084	0.1012	0.1264	0.0842	0.1068	0.1020	0.1284	0.0842	170-180	0.0096	118.1	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 47.432 lm

%lum = 40.2%
%lamp = 40.2%

Conical surface Flux(120deg): 76.714 lm

%lum = 65.0%
%lamp = 65.0%


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: 10.0deg/s
Temperature:24.5℃
Operators:xiaoxin
Test Date:2026-09-29

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
Humidity:60.0%
Test Distance:9.000m [K=1.0000]
Remarks:

LUMINANCE LIMITATION CURVES

LUMINANCE LIMITATION CURVES

GLARE	CLASS	ILLUMINANCE (lx)							
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300
		a	b	c	d	e	f	g	h

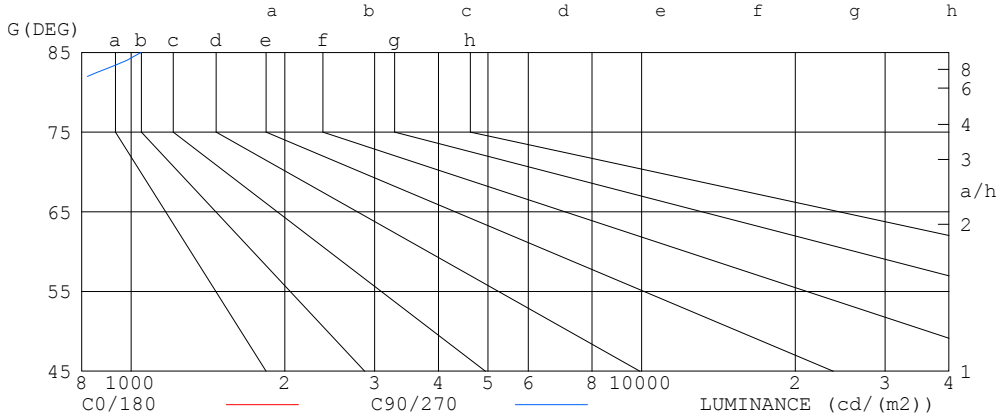


LUMINANCE cd/(m2)		
G(DEG)	C0/180	C90/270
85	31	1046
80	46	743
75	77	733
70	144	670
65	175	715
60	211	724
55	222	507
50	240	533
45	259	484

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: 10.0deg/s
Temperature:24.5℃
Operators:xiaoxin
Test Date:2026-09-29

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
Humidity:60.0%
Test Distance:9.000m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.18	1.18	1.18	1.15	1.15	1.15	1.09	1.09	1.09	1.04	1.04	1.04	.99	.99	.99	.97
1.0	.99	.94	.89	.97	.92	.88	.92	.88	.84	.87	.84	.81	.83	.80	.78	.76
2.0	.85	.77	.70	.82	.75	.69	.78	.72	.67	.74	.69	.65	.71	.66	.63	.60
3.0	.73	.64	.56	.71	.62	.55	.67	.60	.54	.64	.58	.53	.61	.56	.51	.49
4.0	.64	.54	.46	.62	.53	.46	.59	.51	.45	.56	.49	.44	.54	.48	.43	.40
5.0	.56	.46	.39	.55	.45	.38	.52	.44	.38	.50	.43	.37	.48	.41	.36	.34
6.0	.50	.40	.33	.49	.40	.33	.47	.38	.32	.45	.37	.32	.43	.36	.31	.29
7.0	.45	.35	.29	.44	.35	.29	.42	.34	.28	.40	.33	.28	.39	.32	.27	.25
8.0	.41	.32	.25	.40	.31	.25	.38	.30	.25	.37	.30	.24	.35	.29	.24	.22
9.0	.37	.28	.23	.36	.28	.22	.35	.27	.22	.34	.27	.22	.32	.26	.21	.19
10.0	.34	.26	.20	.33	.25	.20	.32	.25	.20	.31	.24	.20	.30	.24	.19	.17

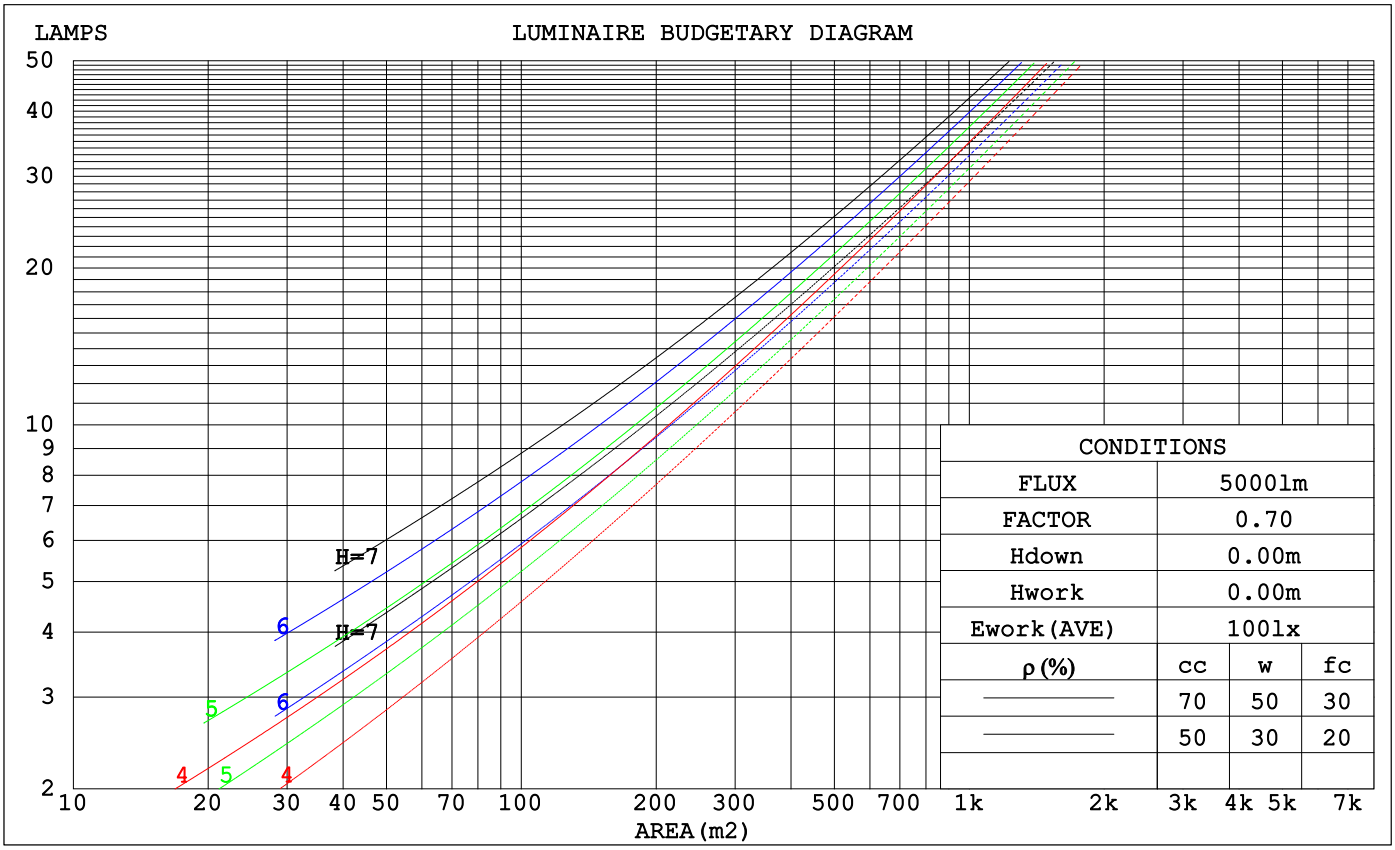

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: 10.0deg/s
Temperature:24.5℃
Operators:xiaoxin
Test Date:2026-09-29

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
Humidity:60.0%
Test Distance:9.000m [K=1.0000]
Remarks:

WEC AND CCEC

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coeffcients(WEC)									
0.0																
1.0	.381	.216	.069	.372	.212	.067	.357	.205	.065	.343	.198	.063	.330	.191	.062	
2.0	.341	.187	.057	.333	.184	.057	.320	.178	.055	.307	.172	.054	.295	.167	.053	
3.0	.307	.163	.049	.300	.161	.048	.288	.156	.047	.276	.151	.046	.266	.147	.046	
4.0	.278	.144	.042	.272	.142	.042	.261	.138	.041	.250	.135	.041	.241	.131	.040	
5.0	.253	.129	.037	.248	.127	.037	.238	.124	.036	.229	.121	.036	.220	.118	.035	
6.0	.232	.116	.033	.227	.115	.033	.218	.112	.033	.210	.109	.032	.202	.107	.032	
7.0	.214	.106	.030	.210	.104	.030	.202	.102	.029	.194	.100	.029	.187	.097	.029	
8.0	.198	.097	.027	.194	.096	.027	.187	.094	.027	.181	.092	.026	.174	.089	.026	
9.0	.185	.089	.025	.181	.088	.025	.175	.086	.024	.169	.085	.024	.163	.083	.024	
10.0	.173	.083	.023	.170	.082	.023	.164	.080	.023	.158	.079	.022	.153	.077	.022	

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.214	.214	.214	.183	.183	.183	.125	.125	.125	.072	.072	.072	.023	.023	.023	
1.0	.209	.180	.153	.179	.154	.132	.122	.106	.091	.070	.061	.053	.023	.020	.017	
2.0	.203	.156	.116	.174	.134	.101	.119	.093	.070	.069	.054	.041	.022	.017	.013	
3.0	.196	.139	.093	.168	.120	.081	.115	.083	.057	.067	.049	.033	.021	.016	.011	
4.0	.188	.126	.079	.162	.109	.068	.111	.076	.048	.064	.044	.028	.021	.014	.009	
5.0	.181	.116	.068	.155	.100	.059	.107	.070	.042	.062	.041	.025	.020	.013	.008	
6.0	.173	.108	.061	.149	.093	.053	.103	.065	.038	.060	.038	.022	.019	.013	.007	
7.0	.166	.101	.056	.143	.088	.049	.099	.061	.034	.057	.036	.021	.018	.012	.007	
8.0	.159	.095	.052	.137	.083	.045	.095	.058	.032	.055	.034	.019	.018	.011	.006	
9.0	.152	.090	.049	.131	.079	.042	.091	.055	.030	.053	.033	.018	.017	.011	.006	
10.0	.146	.086	.046	.126	.075	.040	.087	.053	.029	.051	.031	.017	.017	.010	.006	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: 10.0deg/s
Temperature:24.5℃
Operators:xiaoxin
Test Date:2026-09-29

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
Humidity:60.0%
Test Distance:9.000m [K=1.0000]
Remarks:

UGR(Unified Glare Rating) Table

ceiling/cavity		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
x = 2H	y = 2H	8.4	10.0	8.7	10.3	10.6	11.7	13.4	12.1	13.6	13.9
	3H	9.4	10.9	9.7	11.2	11.5	14.3	15.8	14.7	16.1	16.4
	4H	9.6	11.0	9.9	11.3	11.7	15.3	16.8	15.7	17.1	17.4
	6H	9.6	11.0	10.0	11.3	11.7	16.0	17.4	16.4	17.8	18.1
	8H	9.6	10.9	10.0	11.2	11.6	16.4	17.7	16.8	18.1	18.5
	12H	9.5	10.8	9.9	11.2	11.5	16.8	18.1	17.2	18.5	18.8
4H	2H	10.0	11.5	10.4	11.8	12.1	12.4	13.8	12.7	14.1	14.5
	3H	11.4	12.6	11.8	13.0	13.4	15.1	16.4	15.5	16.7	17.1
	4H	11.7	12.9	12.1	13.3	13.7	16.2	17.4	16.7	17.8	18.2
	6H	11.8	12.9	12.3	13.3	13.7	17.1	18.2	17.6	18.6	19.0
	8H	11.8	12.8	12.3	13.3	13.7	17.6	18.6	18.1	19.0	19.5
	12H	11.8	12.8	12.3	13.2	13.7	18.1	19.0	18.6	19.5	20.0
8H	4H	12.7	13.7	13.2	14.1	14.6	16.4	17.4	16.9	17.8	18.3
	6H	13.1	14.0	13.6	14.4	14.9	17.5	18.4	18.0	18.8	19.3
	8H	13.3	14.0	13.8	14.5	15.0	18.2	18.9	18.7	19.4	19.9
	12H	13.4	14.0	13.9	14.5	15.1	18.9	19.5	19.4	20.0	20.6
12H	4H	12.9	13.8	13.4	14.3	14.7	16.4	17.3	16.9	17.8	18.2
	6H	13.5	14.3	14.0	14.8	15.3	17.6	18.4	18.1	18.8	19.4
	8H	13.8	14.5	14.4	15.0	15.5	18.3	19.0	18.8	19.5	20.0
Variations with the observer position at spacings(CIE Pub.117):											
S = 1.0H		+ 0.1 / - 0.2					+ 0.1 / - 0.1				
1.5H		+ 0.7 / - 0.6					+ 0.2 / - 0.3				
2.0H		+ 0.5 / - 0.8					+ 0.3 / - 0.5				

CIE Pub.117, 118.1 lm Total Lamp Luminous Flux Corrected (8log(F/F0) = -7.4)
Area: 0.0828 m2

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: 10.0deg/s
Temperature:24.5℃
Operators:xiaoxin
Test Date:2026-09-29

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
Humidity:60.0%
Test Distance:9.000m [K=1.0000]
Remarks:


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) k(RI) x RCR = 5									
k = 0.60	50	38	30	50	37	30	48	37	30	23
0.80	60	47	39	59	46	39	57	46	38	30
1.00	68	56	47	67	55	47	64	57	46	38
1.25	76	63	55	74	62	54	71	61	54	45
1.50	81	69	61	79	68	60	76	66	59	50
2.00	89	78	70	86	77	69	82	74	68	59
2.50	93	84	76	91	82	75	86	79	73	63
3.00	97	88	81	95	87	80	90	83	78	68
4.00	102	95	89	99	93	87	94	89	84	74
5.00	105	98	93	102	96	91	97	92	88	78
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004	Suspended								SHRNOM = 1.25	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: 10.0deg/s
Temperature:24.5℃
Operators:xiaoxin
Test Date:2026-09-29

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
Humidity:60.0%
Test Distance:9.000m [K=1.0000]
Remarks:


ISOCANDELA DIAGRAM

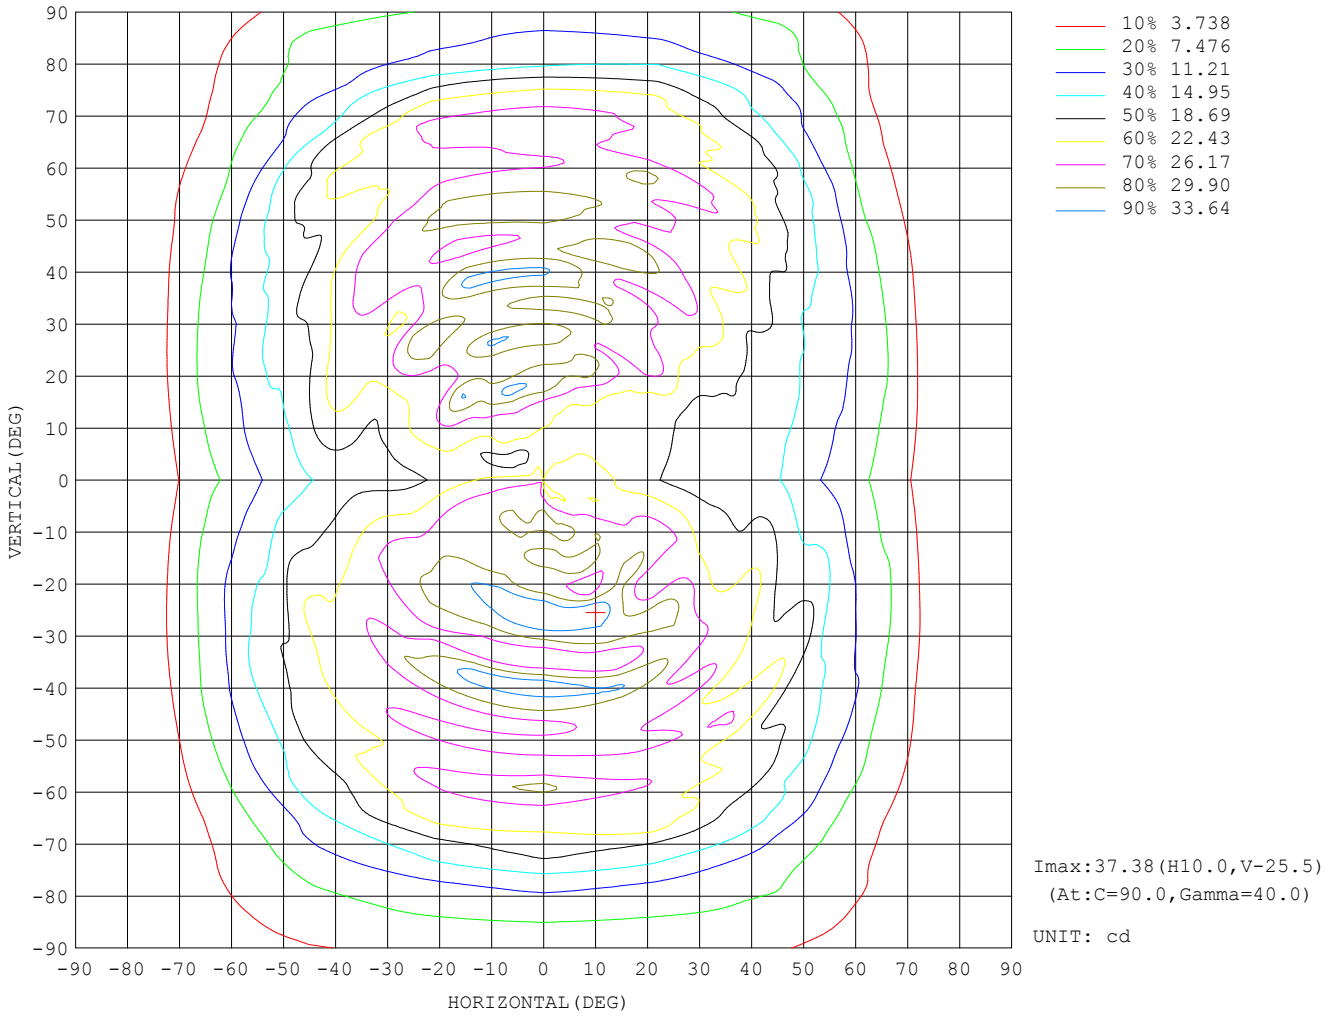

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: 10.0deg/s
Temperature:24.5℃
Operators:xiaoxin
Test Date:2026-09-29

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
Humidity:60.0%
Test Distance:9.000m [K=1.0000]
Remarks:

AAI Figure

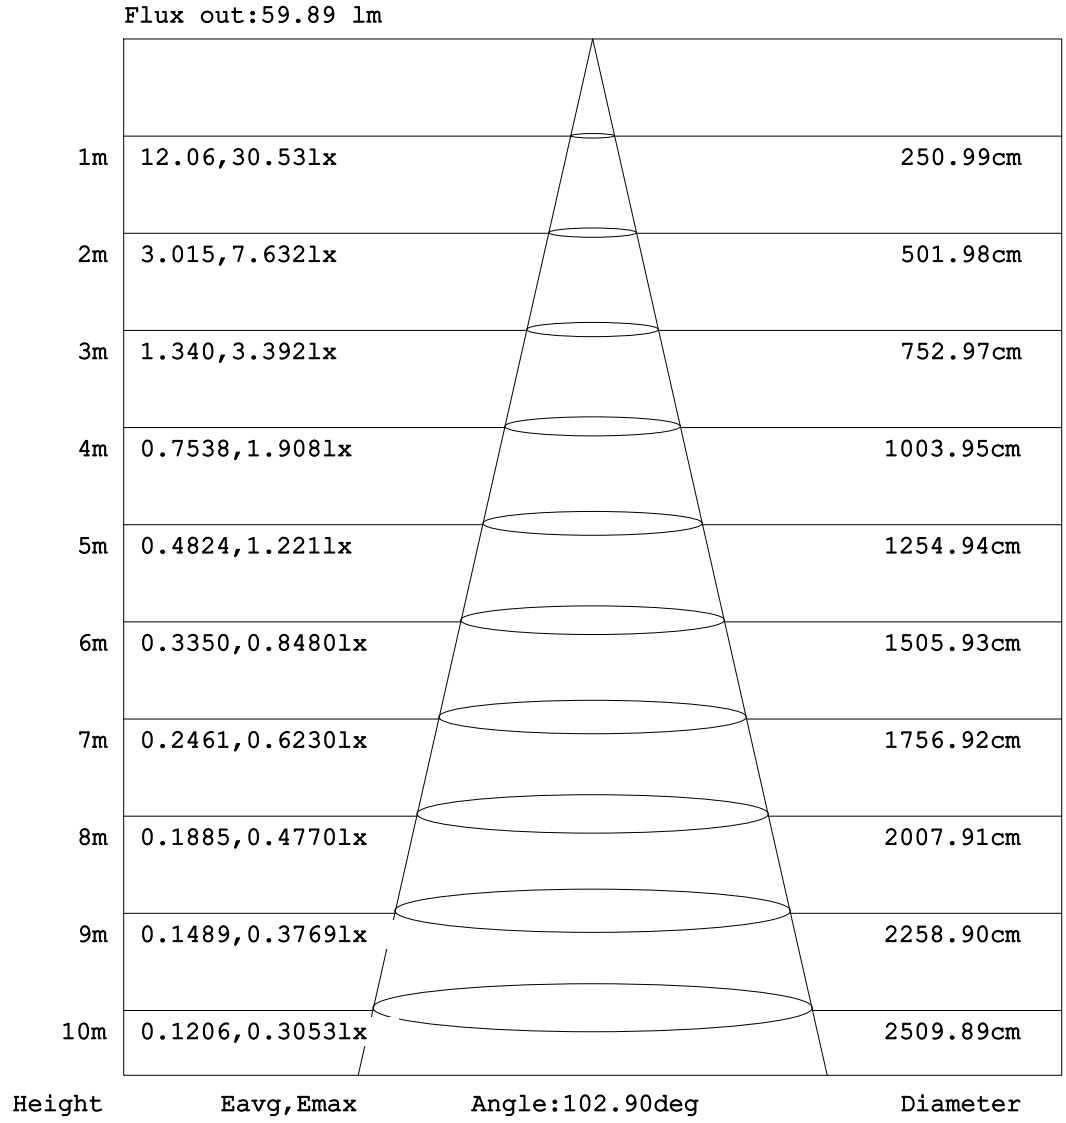


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: 10.0deg/s
Temperature:24.5℃
Operators:xiaoxin
Test Date:2026-09-29

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
Humidity:60.0%
Test Distance:9.000m [K=1.0000]
Remarks:

ISOLUX DIAGRAM

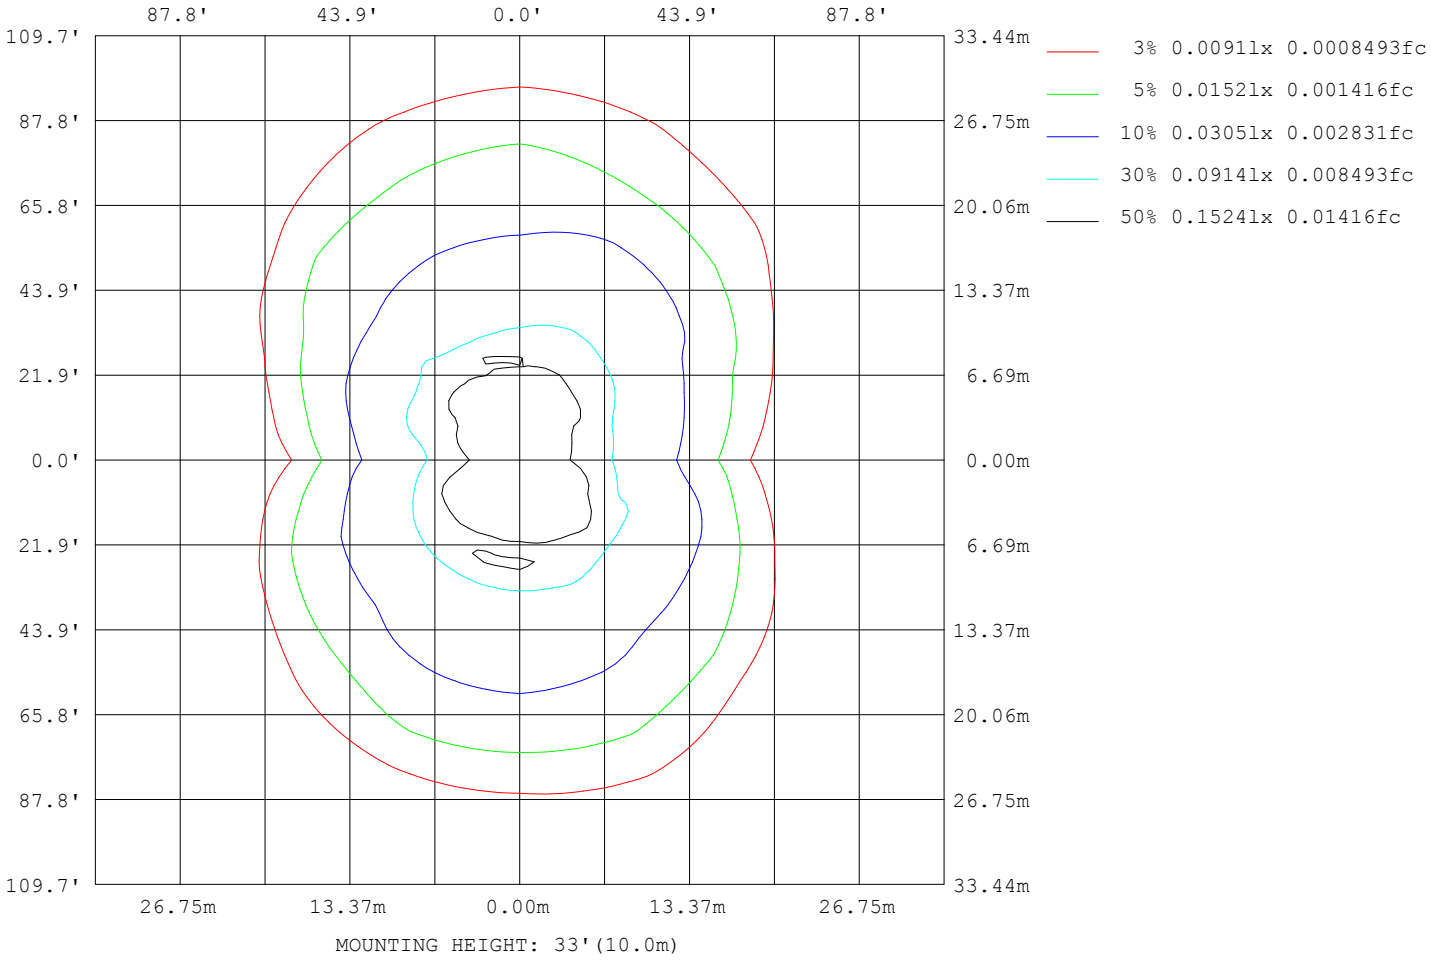

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: 10.0deg/s
Temperature:24.5℃
Operators:xiaoxin
Test Date:2026-09-29

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
Humidity:60.0%
Test Distance:9.000m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:120.06V I:0.0213A P:1.5234W PF:0.5966 Freq:60.00Hz Lamp Flux:118.102x1 lm		
NAME: 30763CRBKAB	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	178
L_0~180(75)av	75
L_0~180(85)av	29
L_90~270(65)av	910
L_90~270(75)av	1068
L_90~270(85)av	1632
L_45(65)av	567
L_45(75)av	568
L_45(85)av	1004

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: 10.0deg/s
Temperature:24.5℃
Operators:xiaoxin
Test Date:2026-09-29

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
Humidity:60.0%
Test Distance:9.000m [K=1.0000]
Remarks:

Planar Illuminance Curve

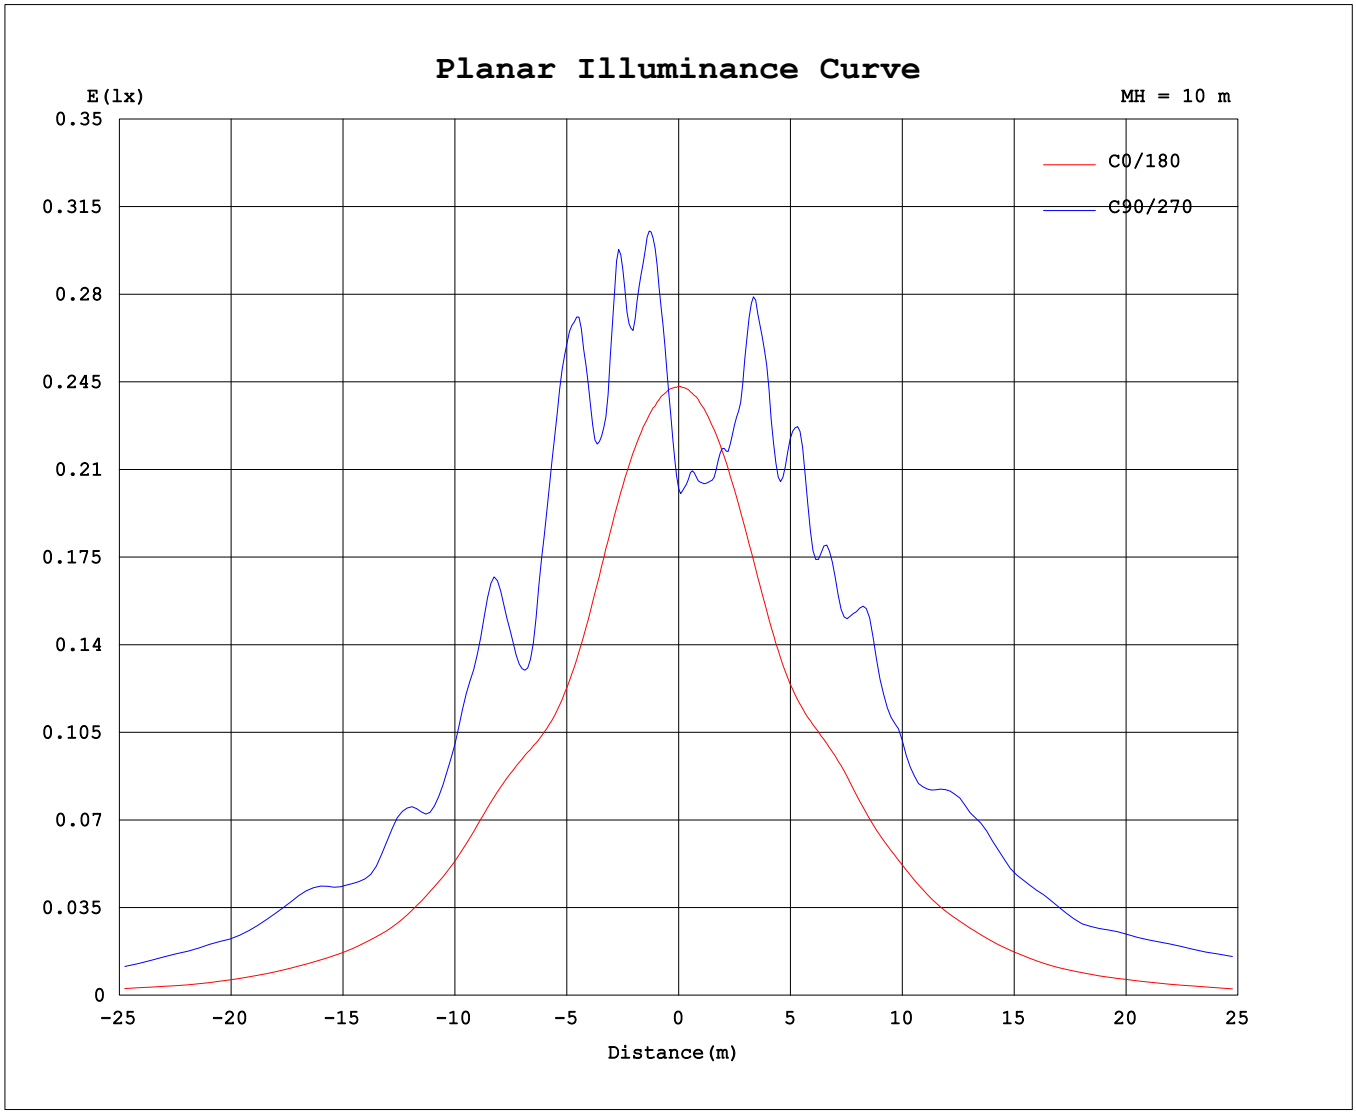

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: 10.0deg/s
Temperature:24.5℃
Operators:xiaoxin
Test Date:2026-09-29

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
Humidity:60.0%
Test Distance:9.000m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Table--1 UNIT: cd

γ (DEG) \ C(DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	24.1	24.1	24.1	24.1	24.1	24.1	24.1	24.1	24.1	24.1	24.1	24.1	24.1	24.1	24.1	24.1			
5	23.9	23.6	21.6	26.4	34.2	28.6	26.1	25.6	23.9	19.3	17.9	21.1	24.8	20.7	20.5	23.3			
10	23.2	21.9	26.4	33.5	35.4	29.6	28.1	26.3	23.1	16.6	21.9	26.0	26.7	20.7	19.8	21.0			
15	21.8	23.0	29.5	30.4	39.4	27.6	24.7	26.8	21.6	20.0	24.2	29.7	30.9	21.2	19.6	19.7			
20	19.6	26.6	25.9	29.2	31.7	29.7	26.5	25.8	19.6	23.1	29.7	34.0	38.5	27.0	18.3	19.5			
25	17.5	27.0	29.0	34.0	43.1	33.9	29.9	24.1	17.6	23.5	25.8	30.7	33.1	30.3	21.3	18.2			
30	16.6	23.8	24.7	36.4	37.4	28.8	29.1	25.1	17.0	20.5	26.5	32.3	36.1	27.5	26.4	16.5			
35	17.0	20.7	31.6	27.5	28.3	24.1	24.4	24.2	17.3	18.8	32.1	31.1	36.2	29.2	22.5	16.8			
40	17.0	20.0	28.2	33.2	43.7	34.4	24.6	21.8	16.1	23.9	21.1	38.1	41.0	25.1	23.3	17.5			
45	15.1	23.0	24.3	30.0	33.8	27.1	24.1	20.5	14.6	23.2	26.4	29.0	34.3	32.9	23.3	15.9			
50	12.7	18.0	21.7	29.1	33.8	26.8	23.1	21.5	12.6	17.8	28.2	31.1	36.9	24.4	23.1	15.7			
55	10.5	20.5	26.0	27.0	28.7	22.5	22.6	17.2	10.7	17.4	23.4	32.9	36.8	27.9	20.7	14.3			
60	8.66	14.8	19.4	28.9	35.7	27.5	19.6	16.1	8.23	14.5	19.8	27.3	31.4	30.0	22.2	12.8			
65	6.07	12.5	20.3	25.7	29.8	24.0	17.1	12.7	6.40	12.4	22.9	27.7	33.8	23.4	19.1	11.5			
70	4.04	9.52	16.2	22.3	22.6	18.6	15.4	9.43	3.79	10.0	19.6	29.6	33.8	24.7	17.6	8.55			
75	1.63	6.36	11.2	16.0	18.7	13.9	11.1	6.24	1.60	6.48	13.0	22.2	27.1	22.2	13.5	5.36			
80	0.65	3.68	8.11	10.8	12.7	9.90	7.83	3.43	0.63	4.07	9.44	14.8	17.4	15.2	10.9	3.35			
85	0.22	2.62	6.73	7.51	9.00	6.77	5.85	2.34	0.19	2.52	8.42	11.0	14.6	11.1	7.98	2.27			
90	0.00	1.38	3.97	4.83	5.69	4.37	3.27	1.16	0.00	1.43	5.24	8.37	9.15	9.39	5.66	1.39			
95	0.00	0.58	2.26	3.32	3.44	2.91	2.54	0.45	0.01	0.60	3.73	3.83	4.95	4.52	5.09	0.75			
100	0.01	0.08	1.15	2.53	2.05	1.70	1.64	0.06	0.02	0.11	1.02	1.78	2.41	1.92	1.66	0.21			
105	0.01	0.01	0.72	1.40	1.14	0.76	0.44	0.03	0.03	0.04	0.45	1.36	1.95	1.60	0.38	0.03			
110	0.02	0.01	0.38	0.47	0.43	0.21	0.09	0.04	0.04	0.05	0.16	0.54	1.16	0.81	0.22	0.03			
115	0.03	0.02	0.04	0.18	0.22	0.12	0.06	0.05	0.04	0.06	0.08	0.35	0.52	0.35	0.06	0.04			
120	0.04	0.03	0.05	0.08	0.10	0.08	0.07	0.05	0.06	0.07	0.08	0.11	0.15	0.09	0.06	0.04			
125	0.04	0.03	0.05	0.08	0.11	0.09	0.07	0.06	0.06	0.08	0.09	0.11	0.13	0.10	0.07	0.05			
130	0.05	0.04	0.05	0.09	0.12	0.09	0.08	0.06	0.07	0.09	0.10	0.12	0.13	0.09	0.07	0.06			
135	0.06	0.05	0.06	0.09	0.12	0.10	0.08	0.07	0.08	0.10	0.10	0.12	0.14	0.10	0.08	0.07			
140	0.07	0.06	0.07	0.10	0.13	0.10	0.09	0.07	0.09	0.10	0.10	0.13	0.14	0.10	0.08	0.07			
145	0.08	0.07	0.07	0.10	0.12	0.10	0.09	0.08	0.09	0.10	0.10	0.12	0.14	0.10	0.08	0.07			
150	0.08	0.07	0.08	0.10	0.13	0.10	0.09	0.08	0.10	0.10	0.10	0.12	0.13	0.09	0.08	0.07			
155	0.09	0.08	0.08	0.10	0.12	0.10	0.09	0.08	0.10	0.10	0.10	0.11	0.12	0.09	0.08	0.08			
160	0.09	0.09	0.08	0.10	0.12	0.10	0.09	0.08	0.10	0.10	0.10	0.12	0.12	0.09	0.08	0.08			
165	0.10	0.10	0.09	0.10	0.12	0.10	0.09	0.08	0.10	0.11	0.10	0.11	0.12	0.09	0.08	0.08			
170	0.10	0.10	0.09	0.10	0.12	0.10	0.09	0.08	0.11	0.10	0.10	0.11	0.12	0.09	0.08	0.08			
175	0.11	0.10	0.10	0.11	0.13	0.10	0.09	0.09	0.11	0.11	0.10	0.11	0.12	0.09	0.08	0.08			
180	0.11	0.11	0.10	0.11	0.13	0.10	0.08	0.08	0.11	0.11	0.10	0.11	0.13	0.10	0.08	0.09			

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: 10.0deg/s
Temperature:24.5℃
Operators:xiaoxin
Test Date:2026-09-29

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
Humidity:60.0%
Test Distance:9.000m [K=1.0000]
Remarks: